


Forbes Marshall Multi Station Report

From : 01-03-2020 00:00:00 **To :** 31-03-2020 23:59:59
Interval : Daily **Function :** Average

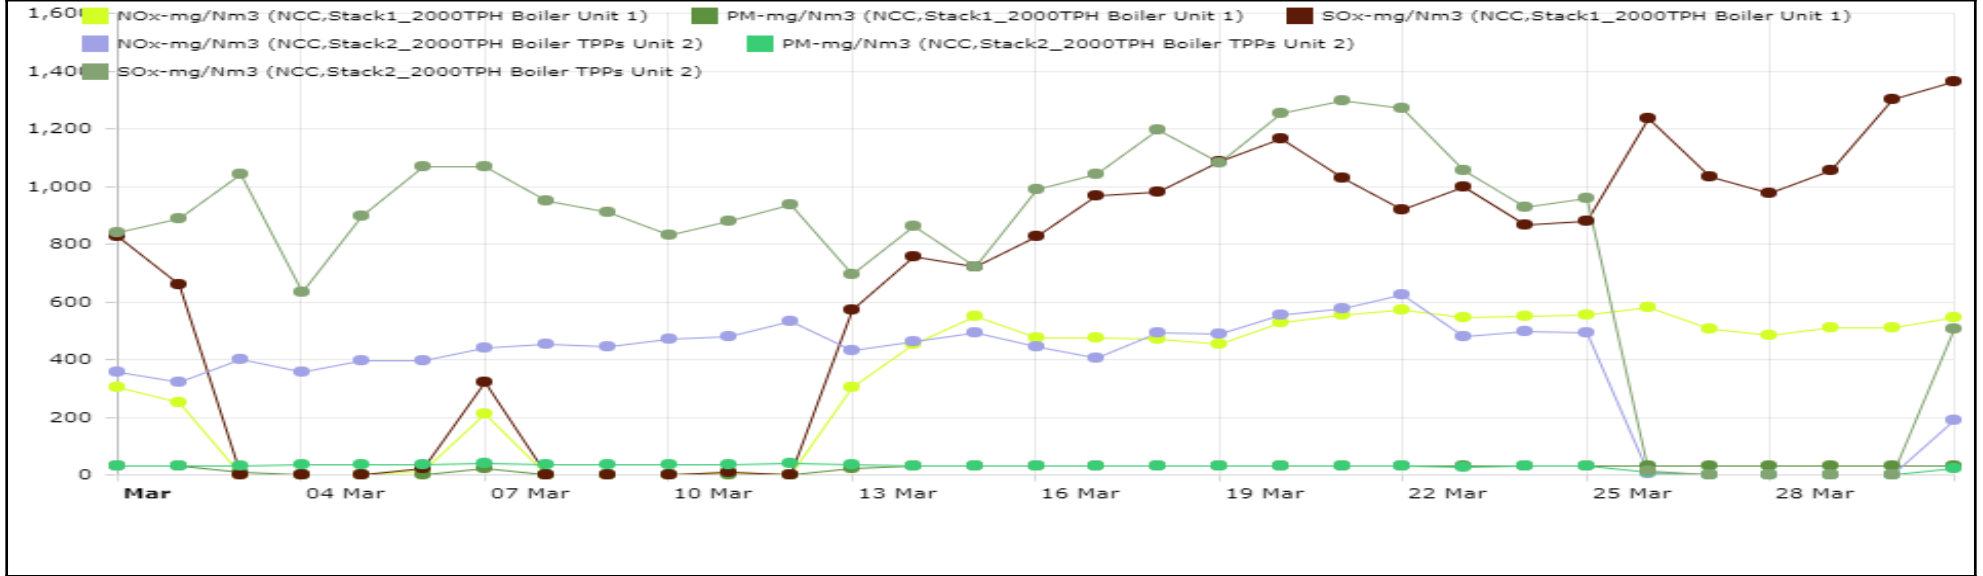

Flag legends: < - Average with less data, C - Calibration mode, M - Maintenance mode, S - Data under scrutiny, B - Bad data, H - High permissible limit crossed, L - Low permissible limit crossed, P - Processed Data, V - Corrected Data, D - Delayed Data, R - Analyzer drift

Calender	NOx Avg	PM Avg	SOx Avg	NOx Avg	PM Avg	SOx Avg
Plant	NCC	NCC	NCC	NCC	NCC	NCC
Station	Stack1_2000TP H Boiler Unit 1	Stack1_2000TP H Boiler Unit 1	Stack1_2000TP Boiler Unit 1	Stack2_2000TP H Boiler TPPs Unit 2	Stack2_2000TP Boiler TPPs Unit 2	Stack2_2000TP Boiler TPPs Unit 2
Units	mg/Nm3	mg/Nm3	mg/Nm3	mg/Nm3	mg/Nm3	mg/Nm3
Range		0 - 50			0 - 50	
01-03-2020 00:00:00	304.29	30.25 H	824.92	355.34	30.32	839.67
02-03-2020 00:00:00	252.53	31.69 HS	661.09	323.05	30.99	886.60
03-03-2020 00:00:00	0.00	7.23 HS	0.00	398.47	32.51	1040.58
04-03-2020 00:00:00	0.00	0.08	0.00	354.05	33.52	631.41
05-03-2020 00:00:00	0.00	0.08	0.00	397.58	35.72	897.24
06-03-2020 00:00:00	15.11	1.05 HS	20.77	394.97	36.93	1066.88
07-03-2020 00:00:00	210.73	23.10 HS	322.14	439.32	37.59	1069.30

Calender	NOx Avg	PM Avg	SOx Avg	NOx Avg	PM Avg	SOx Avg
Plant Station Units Range	NCC Stack1_2000TP H Boiler Unit 1 mg/Nm3	NCC Stack1_2000TP H Boiler Unit 1 mg/Nm3 0 - 50	NCC Stack1_2000TPH Boiler Unit 1 mg/Nm3	NCC Stack2_2000TP H Boiler TPPs Unit 2 mg/Nm3	NCC Stack2_2000TPH Boiler TPPs Unit 2 mg/Nm3 0 - 50	NCC Stack2_2000TPH Boiler TPPs Unit 2 mg/Nm3
08-03-2020 00:00:00	0.00	0.03	0.00	453.09	35.07	951.61
09-03-2020 00:00:00	0.00	0.02	0.00	443.65	35.35	911.02
10-03-2020 00:00:00	0.00	0.04	0.00	469.89	35.51	831.67
11-03-2020 00:00:00	9.11	0.04 B	9.13	478.54	37.24	877.53
12-03-2020 00:00:00	0.01	0.12 H	0.20	531.60	37.65	934.26
13-03-2020 00:00:00	304.22	22.11 HS	572.43	430.45	33.87 HS	693.97
14-03-2020 00:00:00	454.82 <	29.29 <	755.32 <	463.22 <	31.61 <	859.96 <
15-03-2020 00:00:00	547.48	29.07	720.12	492.14	29.64	722.50
16-03-2020 00:00:00	473.84	29.38	827.82	446.13	29.21	988.58
17-03-2020 00:00:00	475.40	29.31	966.59	402.20	29.87	1040.40
18-03-2020 00:00:00	470.41	29.68	980.93	491.80	30.17	1193.82
19-03-2020 00:00:00	454.82	30.63	1084.43	487.21	30.99 HS	1082.88
20-03-2020 00:00:00	528.19	29.93	1166.12	553.80	30.50	1254.51
21-03-2020 00:00:00	553.06	29.22	1030.35	575.04	30.81	1294.76
22-03-2020 00:00:00	571.31	28.98	918.89	625.50	32.01 H	1268.60
23-03-2020 00:00:00	543.54	29.21	999.67	480.12	28.53	1055.13
24-03-2020 00:00:00	551.39	29.11	864.07	496.36	29.25 H	926.10
25-03-2020 00:00:00	554.82	29.14	878.58	494.47	30.81 H	958.36
26-03-2020 00:00:00	579.12	30.96	1235.54	4.10	6.66 HS	11.67
27-03-2020 00:00:00	506.37	30.10	1035.05	0.03	0.06	0.03
28-03-2020 00:00:00	482.95	30.96	976.68	0.02	0.03	0.02
29-03-2020 00:00:00	510.34	30.58	1054.65	0.00	0.05	0.00
30-03-2020 00:00:00	508.24	32.23	1302.70	0.05	0.02 S	0.00
31-03-2020 00:00:00	546.52	31.88	1362.43	190.36	23.20 HS	506.82

Report Summary

Average	335.76	21.14	663.57	376.54	27.28	799.87
Maximum	579.12	32.23	1362.43	625.50	37.65	1294.76
Minimum	0.00	0.02	0.00	0.00	0.02	0.00
Std.Deviation	234.17	13.33	474.25	185.25	12.02	395.92
Geom.Mean	220.07	5.96	458.42	104.24	12.80	181.59
Median	470.41	29.21	827.82	443.65	30.81	911.02
Mode	0.00	23.10	0.00	430.45	30.99	1040.58
Total Active Duration						