


**Forbes Marshall
Multi Station Report**

From : 01-03-2020 00:00:00 **To :** 31-03-2020 23:59:59
Interval : Daily **Function :** Average

Maximum 10 parameters can be exported in pdf format.

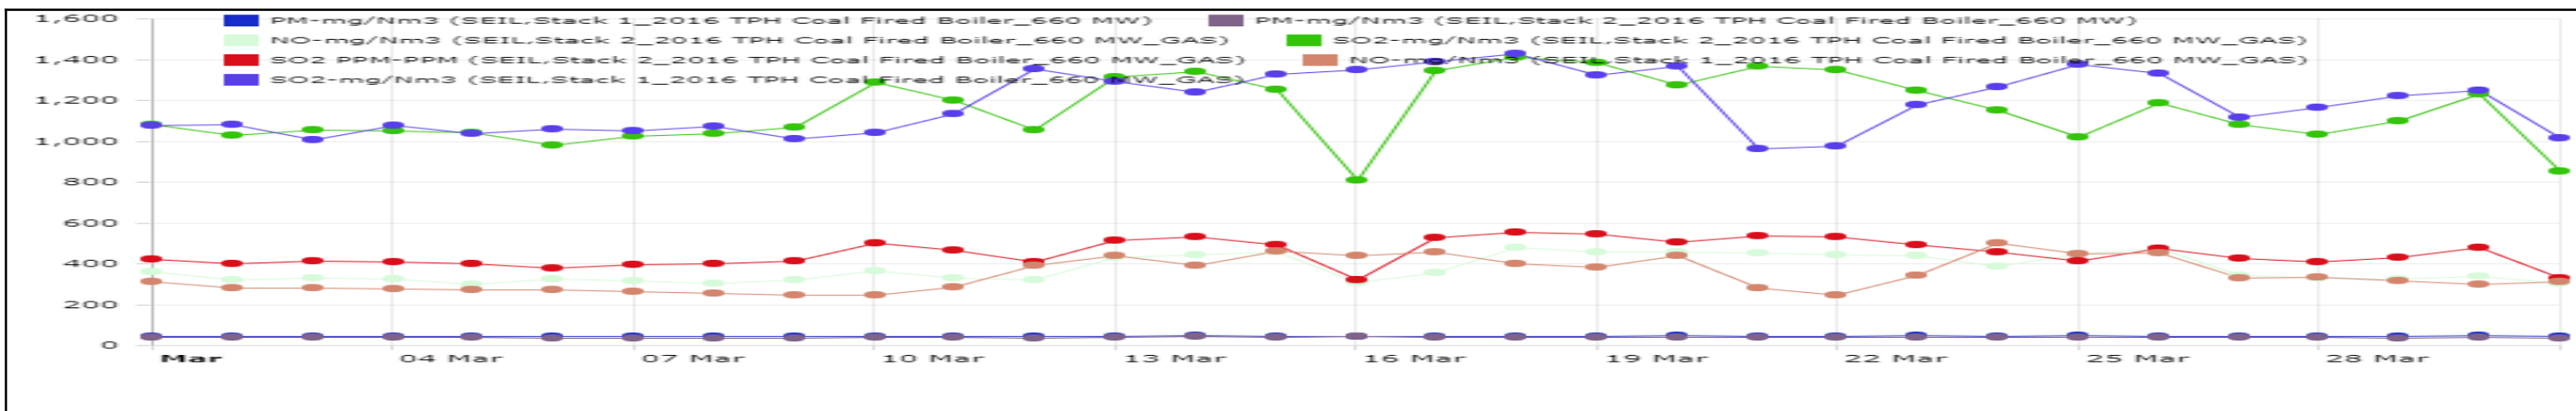

Flag legends: < - Average with less data, C - Calibration mode, M - Maintenance mode, S - Data under scrutiny, B - Bad data, H - High permissible limit crossed, L - Low permissible limit crossed, P - Processed Data, V - Corrected Data, D - Delayed Data.

Calender	PM Avg	PM Avg	NO Avg	SO2 Avg	SO2 PPM Avg	NO Avg	SO2 Avg			
Plant	SEIL	SEIL	SEIL	SEIL	SEIL	SEIL	SEIL			
Station	Stack 1_2016 TPH Coal Fired Boiler_660 MW	Stack 2_2016 TPH Coal Fired Boiler_660 MW	Stack 2_2016 TPH Coal Fired Boiler_660 MW_GAS	Stack 2_2016 TPH Coal Fired Boiler_660 MW_GAS	Stack 2_2016 TPH Coal Fired Boiler_660 MW_GAS	Stack 1_2016 TPH Coal Fired Boiler_660 MW_GAS	Stack 1_2016 TPH Coal Fired Boiler_660 MW_GAS			
Units	mg/Nm3	mg/Nm3	mg/Nm3	mg/Nm3	PPM	mg/Nm3	mg/Nm3			
Range	0 - 50	0 - 50			0 - 1000					
01-03-2020 00:00:00	44.01	41.65 P	358.69 <	1082.78 <	422.30 <	311.76 <	1075.53 <			
02-03-2020 00:00:00	45.01	39.73 P	321.37 MC	1026.48	398.09 MC	280.98 <	1083.35 <			
03-03-2020 00:00:00	44.15	40.81 P	331.80 <	1055.03 <	412.29 <	280.24 <	1008.45 <			
04-03-2020 00:00:00	44.93	39.76 P	323.43 MC	1052.37	408.65 MC	277.92 <	1076.22 <			
05-03-2020 00:00:00	44.62	37.41 P	299.61 <	1040.06 <	400.69 <	274.12 <	1038.66 <			
06-03-2020 00:00:00	43.97	36.43 P	326.11 MC	980.23 MC	377.43 MC	273.12 <	1058.18 <			
07-03-2020 00:00:00	44.06	36.43 P	315.46 <	1026.26 <	394.44 <	265.36 <	1051.64 <			

Calender	PM Avg	PM Avg	NO Avg	SO2 Avg	SO2 PPM Avg	NO Avg	SO2 Avg			
Plant Station	SEIL Stack 1_2016 TPH Coal Fired Boiler_660 MW	SEIL Stack 2_2016 TPH Coal Fired Boiler_660 MW	SEIL Stack 2_2016 TPH Coal Fired Boiler_660 MW_GAS	SEIL Stack 2_2016 TPH Coal Fired Boiler_660 MW_GAS	SEIL Stack 2_2016 TPH Coal Fired Boiler_660 MW_GAS	SEIL Stack 1_2016 TPH Coal Fired Boiler_660 MW_GAS	SEIL Stack 1_2016 TPH Coal Fired Boiler_660 MW_GAS			
Units Range	mg/Nm3 0 - 50	mg/Nm3 0 - 50	mg/Nm3	mg/Nm3	PPM 0 - 1000	mg/Nm3	mg/Nm3			
08-03-2020 00:00:00	44.56	37.07 P	304.17 <	1035.74 <	398.53 <	254.38 <	1073.19 <			
09-03-2020 00:00:00	44.30	37.30 < P	322.23 <	1069.01 <	413.88 <	245.60 <	1012.04 <			
10-03-2020 00:00:00	43.78	41.33 P	364.93 <	1287.39 <	499.64 <	248.07 <	1039.75 <			
11-03-2020 00:00:00	44.69	38.77 P	329.67 <	1200.34 <	465.19 <	286.78 <	1133.17 <			
12-03-2020 00:00:00	45.81	36.77 P	319.42 MC	1056.61	407.52 MC	393.09 <	1353.91 <			
13-03-2020 00:00:00	45.58	39.52 P	431.61 <	1312.91 <	514.25 <	437.78 <	1294.29 <			
14-03-2020 00:00:00	46.41 <	42.14 < P	442.32 <	1338.57 <	530.85 <	391.75 <	1240.11 <			
15-03-2020 00:00:00	45.35	40.64 P	458.04 MC	1251.04	493.84 MC	462.93 <	1326.72 <			
16-03-2020 00:00:00	45.81	42.58 P	309.43 MC	810.19 MC	320.12 MC	440.51 <	1347.86 <			
17-03-2020 00:00:00	45.83	40.87 P	356.21 MC	1344.53	525.58 MC	455.56 <	1388.81 <			
18-03-2020 00:00:00	45.93	40.92 P	477.37 <	1410.66 <	555.06 <	401.84 <	1430.59 <			
19-03-2020 00:00:00	46.00	39.24 P	458.80 MC	1385.57	544.36 MC	380.24 <	1321.50 <			
20-03-2020 00:00:00	46.57	39.95 P	458.79 MC	1275.84	503.78 MC	437.73 <	1366.14 <			
21-03-2020 00:00:00	44.94	40.25 P	450.70 MC	1366.89	537.48 MC	280.47 <	961.22 <			
22-03-2020 00:00:00	44.30	38.32 P	445.51 MC	1348.37	529.99 MC	247.37 <	973.67 <			
23-03-2020 00:00:00	47.29	40.35 P	439.54 <	1249.79 <	490.95 <	343.02 <	1177.09 <			
24-03-2020 00:00:00	45.43	40.67 P	385.52 <	1153.23 <	456.81 <	503.26 <	1263.80 <			
25-03-2020 00:00:00	46.28	39.68 P	449.32 MC	1021.88	411.30 MC	448.73 <	1375.18 <			
26-03-2020 00:00:00	45.26	39.88 P	473.28 MC	1188.45	473.25 MC	452.75 <	1331.01 <			
27-03-2020 00:00:00	45.24	38.84 P	343.78 MC	1079.57	426.72 MC	330.70 <	1114.41 <			
28-03-2020 00:00:00	45.38	38.34 P	328.46 MC	1031.07	406.62 MC	334.17 <	1166.62 <			
29-03-2020 00:00:00	45.83	37.32 P	324.39 MC	1097.78	429.25 MC	317.89 <	1220.23 <			

Calender	PM Avg	PM Avg	NO Avg	SO2 Avg	SO2 PPM Avg	NO Avg	SO2 Avg			
Plant Station	SEIL Stack 1_2016 TPH Coal Fired Boiler_660 MW	SEIL Stack 2_2016 TPH Coal Fired Boiler_660 MW	SEIL Stack 2_2016 TPH Coal Fired Boiler_660 MW_GAS	SEIL Stack 2_2016 TPH Coal Fired Boiler_660 MW_GAS	SEIL Stack 2_2016 TPH Coal Fired Boiler_660 MW_GAS	SEIL Stack 1_2016 TPH Coal Fired Boiler_660 MW_GAS	SEIL Stack 1_2016 TPH Coal Fired Boiler_660 MW_GAS			
Units Range	mg/Nm3 0 - 50	mg/Nm3 0 - 50	mg/Nm3	mg/Nm3	PPM 0 - 1000	mg/Nm3	mg/Nm3			
30-03-2020 00:00:00	46.19	40.40 P	338.86 <	1232.22 <	479.97 <	300.88 <	1249.10 <			
31-03-2020 00:00:00	45.74	36.28 P	303.33 MC	852.68 MC	330.84 MC	311.33 <	1017.15 <			

Report Summary

Average	45.27	39.34	373.94	1150.44	450.31	344.20	1179.67			
Maximum	47.29	42.58	477.37	1410.66	555.06	503.26	1430.59			
Minimum	43.78	36.28	299.61	810.19	320.12	245.60	961.22			
Std.Deviation	0.88	1.78	62.83	157.10	63.14	79.16	144.53			
Geom.Mean	45.26	39.30	369.02	1139.78	445.93	335.72	1171.14			
Median	45.35	39.73	343.78	1097.78	429.25	317.89	1166.62			
Mode	44.01	38.77	364.93	1344.53	406.62	380.24	1075.53			
Total Active										